


GOODWIN
DB

PROVIDE A NEW 1 x 50 DIA COMMUNICATIONS CONDUITS BETWEEN THE PIT AND THE EXTERNAL DUCT TO PROVIDE COMMUNICATIONS CABLE ACCESS FROM THE GOODWIN BUILDING COMMUNICATIONS RACK TO THE NEW COMMUNICATIONS PIT.

PROVIDE TWO (2) NEW 4C x 16mm² SUBMAINS FROM THE EXISTING 63A MCBs IN THE GOODWIN-DB TO THE RELOCATED MECHANICAL SERVICES.

ALP CONFIGURATION

- RESET - WHITE PUSH BUTTON.
- ALERT - AMBER PUSH BUTTON TO ILLUMINATE WHEN ACTIVATED.
- EVACUATION - RED PUSH BUTTON TO ILLUMINATE WHEN ACTIVATED.
- LOCKDOWN - BLUE PUSH BUTTON TO ILLUMINATE WHEN ACTIVATED.

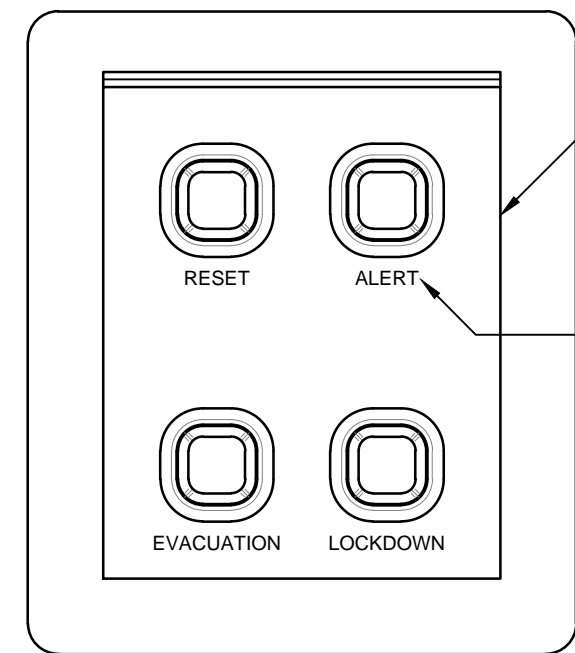

HINGED CLEAR COVER TO PREVENT ACCIDENTAL ACTIVATION.

BLACK ENGRAVED TEXT.

DETAIL A

ALARM PANEL (ALP) ELEVATION VIEW
NOT TO SCALE