



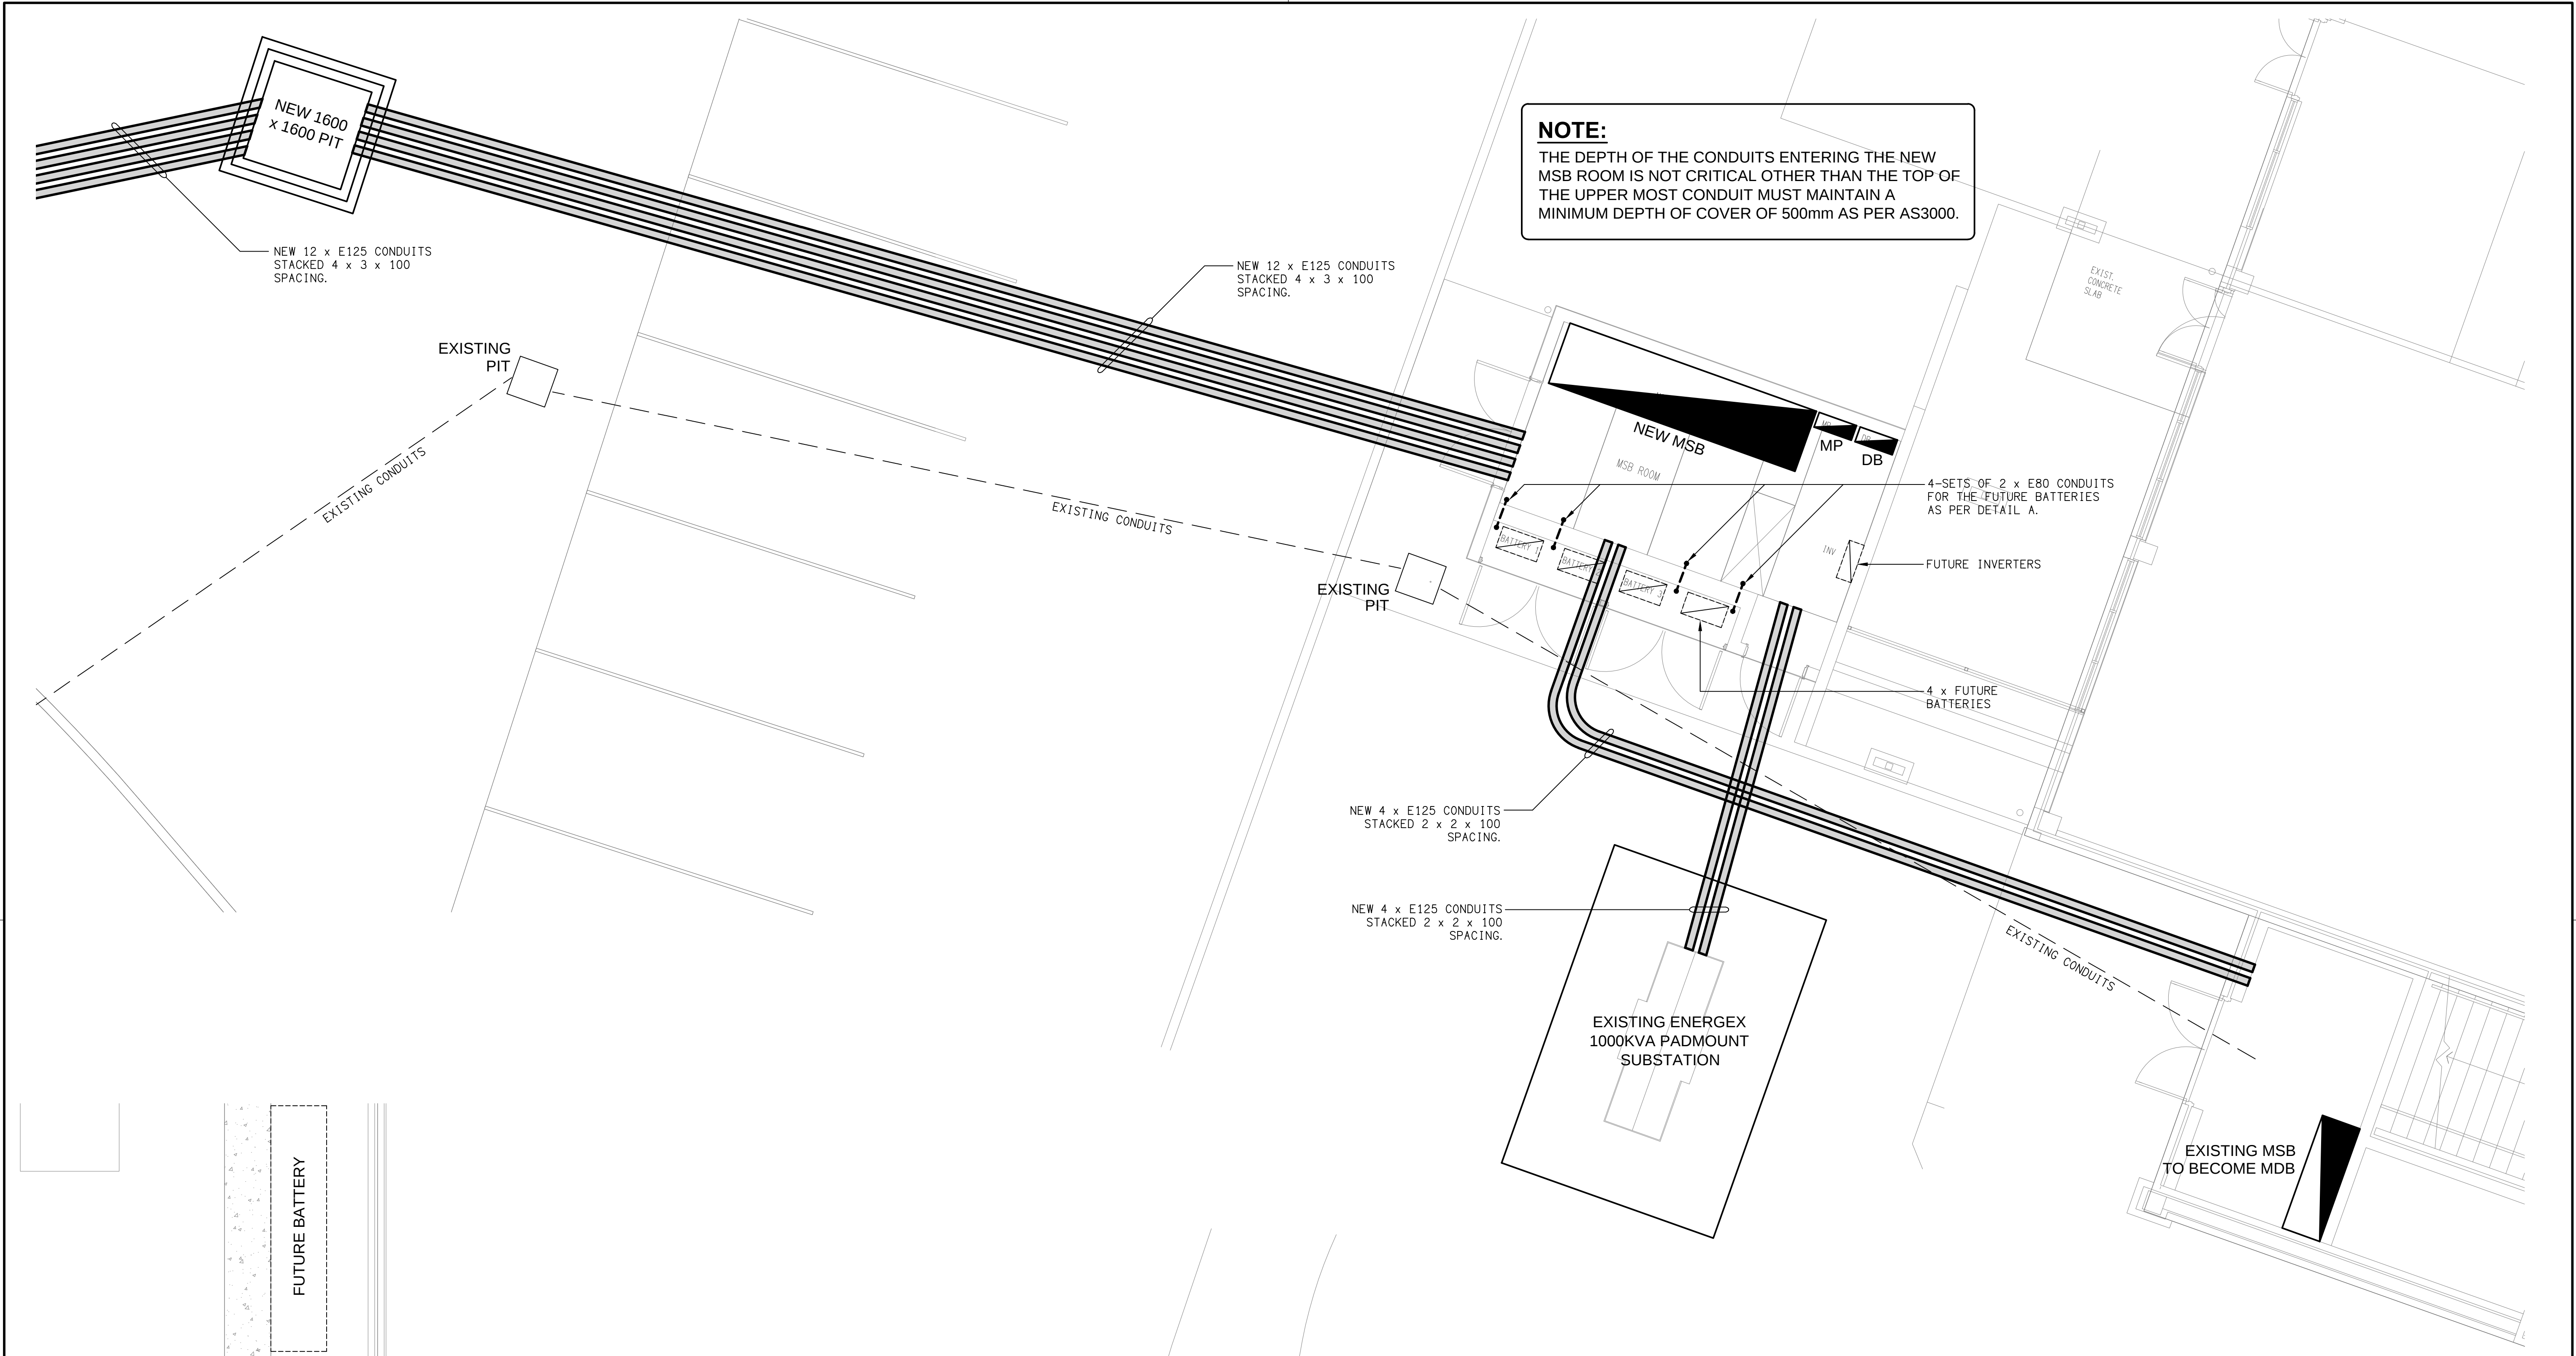

NOTE:
THE DEPTH OF THE CONDUITS ENTERING THE NEW MSB ROOM IS NOT CRITICAL OTHER THAN THE TOP OF THE UPPER MOST CONDUIT MUST MAINTAIN A MINIMUM DEPTH OF COVER OF 500mm AS PER AS3000.

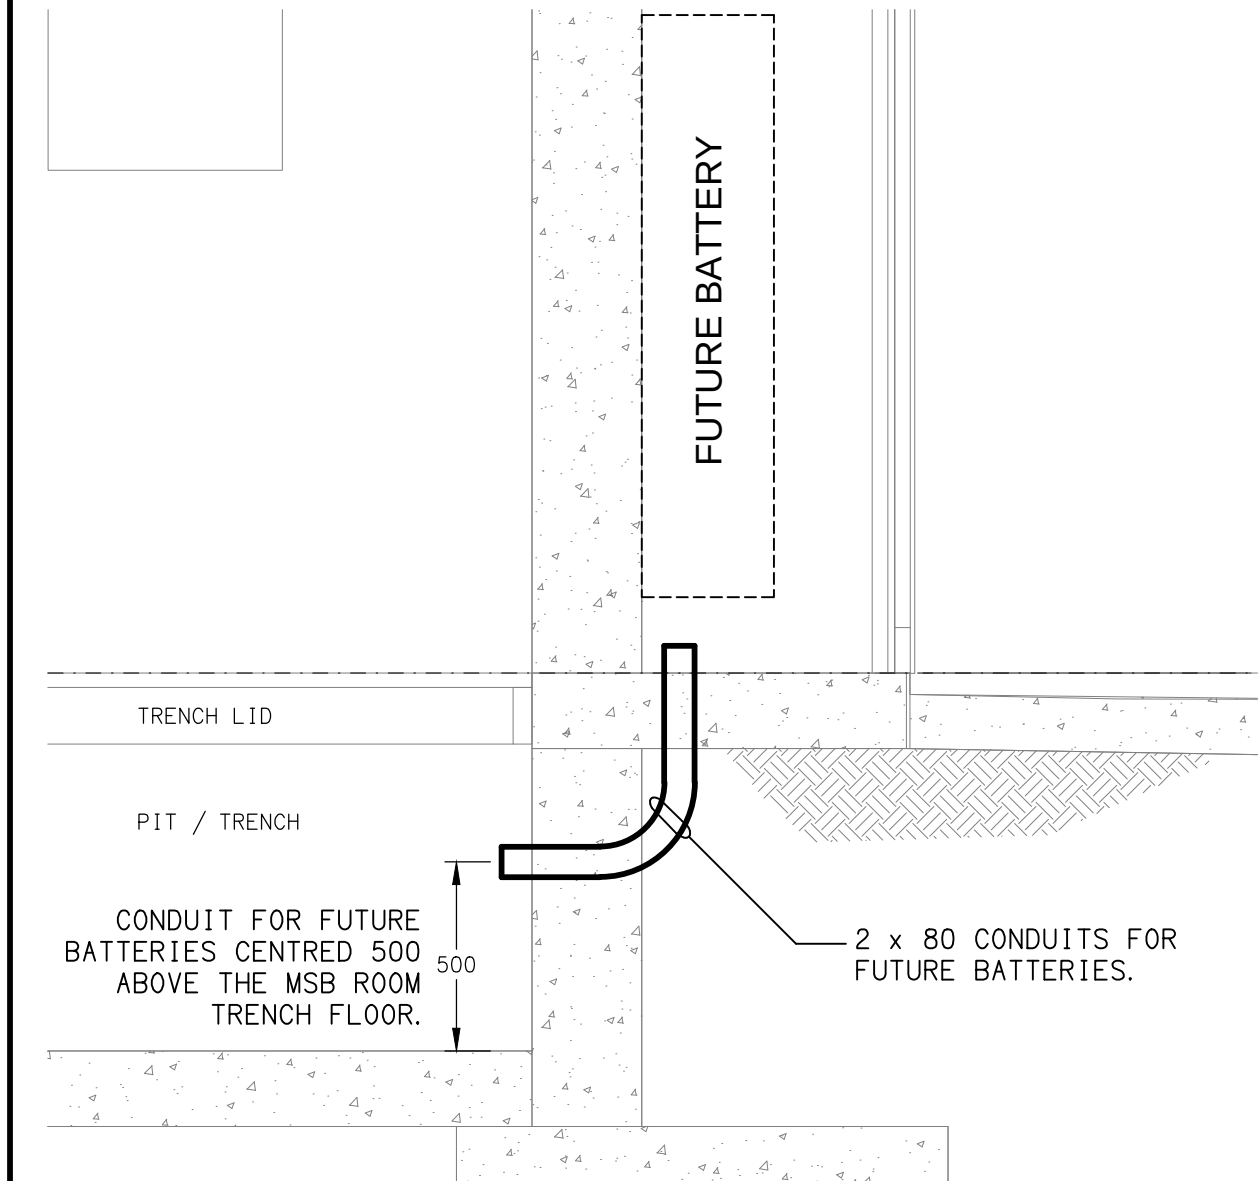

DETAIL A
FUTURE BATTERY CONDUIT SECTION
SCALE 1: 20