

1 x 100mm DIA WHITE AND  
6 x 125mm DIA ORANGE CONDUITS WITHIN  
THE ENERGEX FOOTPATH ZONE.

PROVIDE THE ENCLOSURE DOOR  
WITH A PERMANENT FIXED LABEL  
"NBN". ENSURE THE ENCLOSURE  
HAS 200mm CLEAR ON ALL SIDES.


600 x 600 x 300 DEEP IP55 NBN  
COMPLIANT PCD ENCLOSURE  
SURFACE MOUNTED C/W 2No. 1/4  
TURN 5mm DOUBLE BIT KEY  
CABINET LOCKS ON A DOOR WITH  
120DEG MINIMUM OPENING. THE  
ENCLOSURE IS TO BE  
POWDERCOATED A COLOUR TO MATCH  
THE ADJACENT WALL COLOUR.

**DETAIL**  
PCD MOUNTING  
NOT TO SCALE

- Notes:
- (1) Energex Communication conduit to be 100mm white located top kerbside.
  - (2) Power cable conduits to be 125mm orange, light duty.
  - (3) Separation for conduits - 50mm minimum, up to 160mm desirable.
  - (4) Increased cover required for road crossings.
  - (5) Select Backfill and Pit sand bedding complying with ENERGEX UDCM Section C2
  - (6) For de-rating factors for cables in duct bank, refer to the Plant Rating Manual

**NOTES**

1. CABLE CONDUIT SHALL BE OF THE FOLLOWING TYPE: LIGHT DUTY ELECTRICAL CONDUIT TO AS/NZS 2053. CONDUIT BENDS SHALL HAVE A MINIMUM RADIUS OF 1830mm.
2. CONDUITS SHALL BE 125mm ORANGE FOR ELECTRICAL AND 100mm WHITE (LOCATED TOP KERBSIDE) AS SPECIFIED BY ENERGEX AND SHALL BE SUPPLIED AND INSTALLED BY THE DEVELOPER OR ENERGEX. CONDUITS SHALL BE SECURELY SEALED TO PREVENT INGRESS OF DIRT UNTIL CABLE INSTALLATION AND THEN RESEALED.
3. EACH CONDUIT TO BE FITTED WITH A 6mm BRAID POLYPROPYLENE DRAW ROPE TO PULL IN HAULAGE ROPE. (MINIMUM BREAKING STRENGTH OF 1.0kN.)
4. ENERGEX MAY NEED TO INSTALL AN EARTH WIRE AND EARTH RODS IN CONDUIT TRENCHES FROM THE SUBSTATION SITE.
5. ELECTRICITY SUPPLY CONDUITS AND CABLES SHALL HAVE POLYMERIC CABLE PROTECTION COVER STRIPS PLACED 100mm ABOVE THE TOP CONDUIT FACE OF THE ELECTRICITY SUPPLY CONDUITS AND CABLES. CABLE PROTECTION COVER STRIP SHALL BE LAPPED WHEN PLACED TOGETHER; 100mm MINIMUM ALONG THE LONGITUDINAL AXIS, 40mm MINIMUM ALONG THE TRAVERSE AXIS AND SHALL EXTEND 40mm MINIMUM PAST THE EXTERNAL EDGES OF THE CONDUIT/CABLE BANK.
6. POLYMERIC CABLE PROTECTION COVER SHALL BE A MINIMUM OF 5mm THICK AS DESCRIBED IN THE AUSTRALIAN STANDARD; AS4702 FOR POLYMERIC CABLE PROTECTION COVERS.
7. REDUCED CONDUIT SEPARATION MAY BE ACCEPTED TO AVOID SPECIFIC OBSTACLES
8. MIN. DEPTHS SHOWN ARE THOSE DEPTHS REQUIRED BY CODE OF PRACTICE, WORKS (MINOR ROADS) AND DMR (ARTERIAL ROADS).

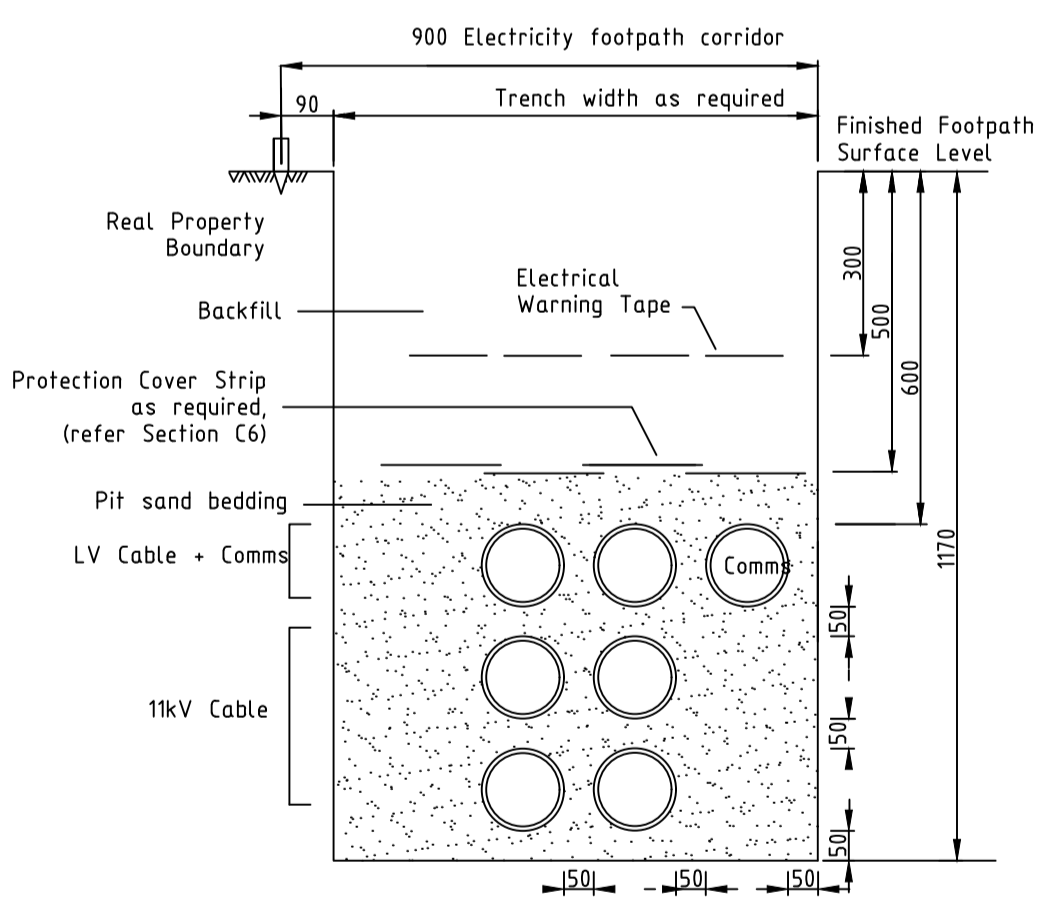

11KV NETWORK



TYPICAL CROSS SECTION - 11KV AND C&I (FOOTPATH ON PUBLIC FOOTPATHS)

ELECTRICAL DESIGN GROUP BRISBANE PTY LTD ACN 092 710 793 TRADING AS: ELECTRICAL DESIGN GROUP	THE COPYRIGHT OF THIS DRAWING REMAINS THE PROPERTY OF THE ELECTRICAL DESIGN GROUP. USE FIGURED DIMENSIONS IN PREFERENCE TO SCALE. ALL DIMENSIONS TO BE VERIFIED ONSITE.	Rohrig (Qld) Pty Ltd ABN 67 093 753 970 QBSA LIC NO 740842 250 Abbotsford Road, Bowen Hills Qld 4006 PO Box 86 Albion DC Qld 4010 T+61 (7) 3257 4411 F+61 (7) 3257 2211 www.rohrig.com.au	<b>ELECTRICAL DESIGN GROUP</b> ELECTRICAL BUILDING SERVICES CONSULTANTS BRISBANE GOLD COAST P.O. Box 15, Sherwood Q.4075 Phone: (07) 3278 4375 Email: brisbane@edg.net.au Web: www.edg.net.au	PROJECT: <b>LLEWELLYN MOTORS SPRINGFIELD - LOT 34</b>	E 80% DEVELOPED REV: DESCRIPTION: DATE:
				PROJECT: <b>LOT 34 AUGUSTA PARKWAY, AUGUSTINE HEIGHTS</b>	DRAWING: <b>ELECTRICAL SERVICES          SITE PLAN</b>
				SCALE: 1:200	PROJECT NO: <b>C3396a</b>
				DRAWING NO: <b>E03</b>	REVISION: <b>E</b>