


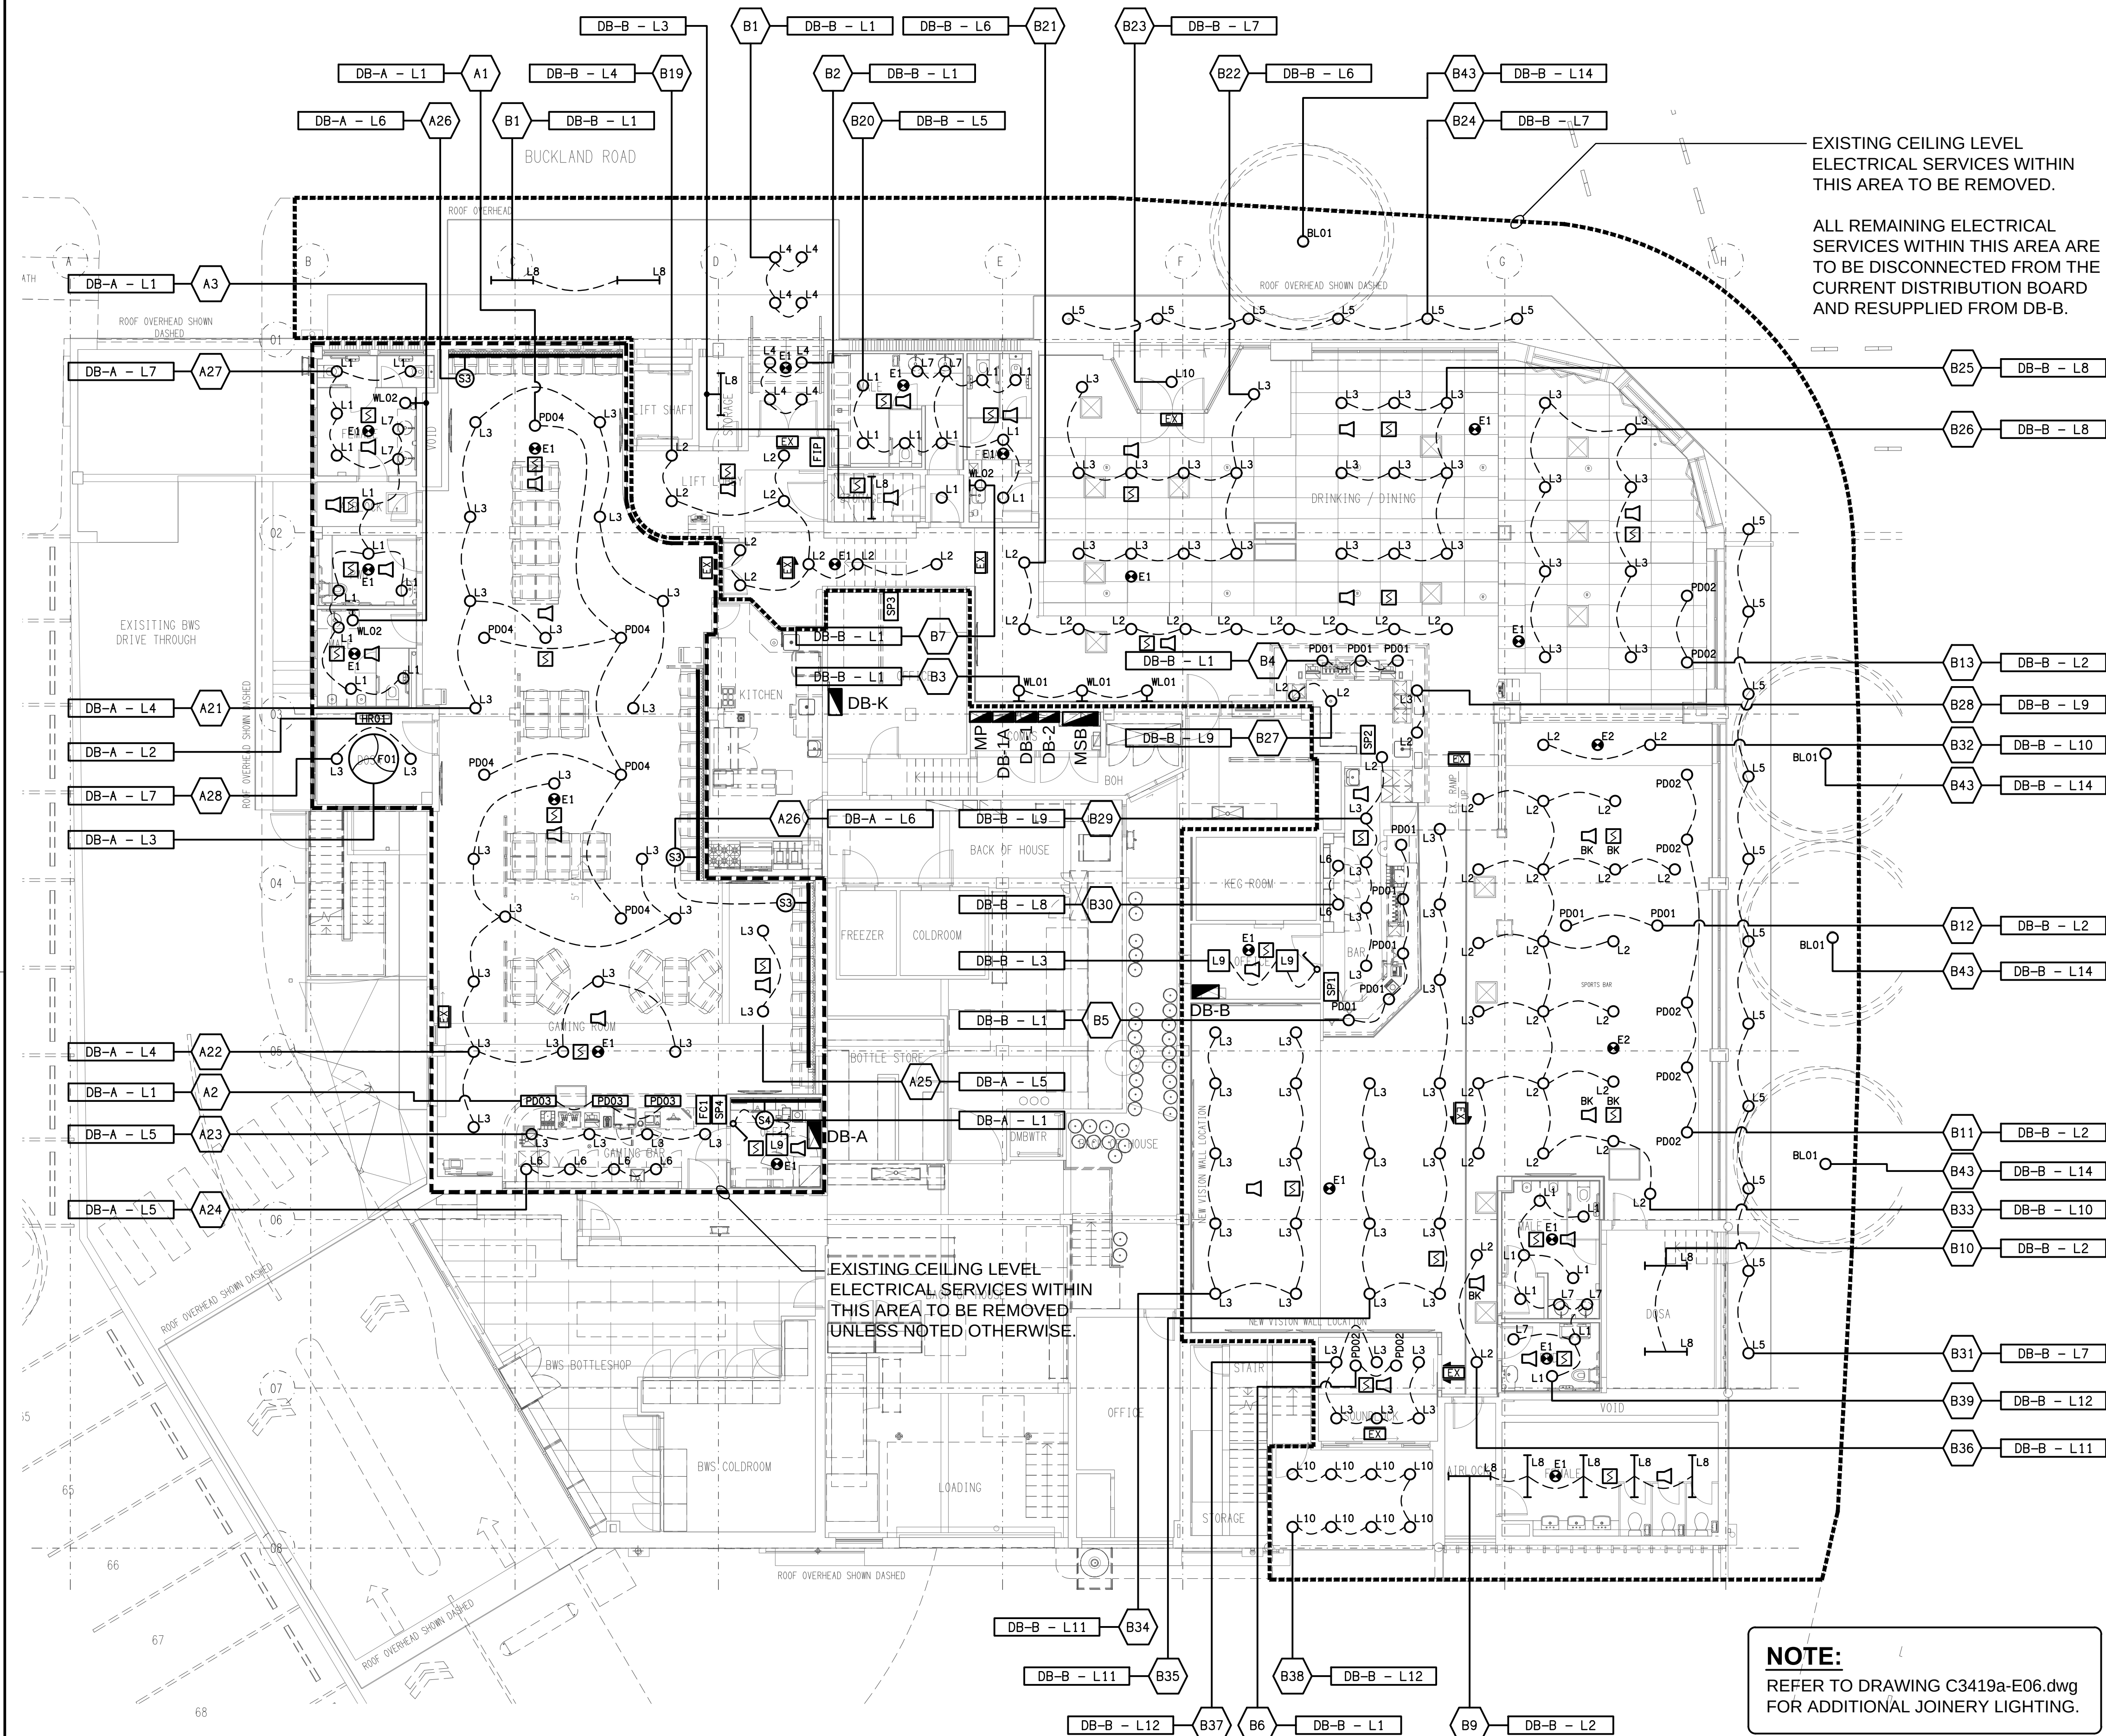

EXISTING CEILING LEVEL
ELECTRICAL SERVICES WITHIN
THIS AREA TO BE REMOVED.

ALL REMAINING ELECTRICAL
SERVICES WITHIN THIS AREA ARE
TO BE DISCONNECTED FROM THE
CURRENT DISTRIBUTION BOARD
AND RESUPPLIED FROM DB-B.

EXISTING CEILING LEVEL
ELECTRICAL SERVICES WITHIN
THIS AREA TO BE REMOVED
UNLESS NOTED OTHERWISE.

NOTE:
REFER TO DRAWING C3419a-E06.dwg
FOR ADDITIONAL JOINERY LIGHTING.