

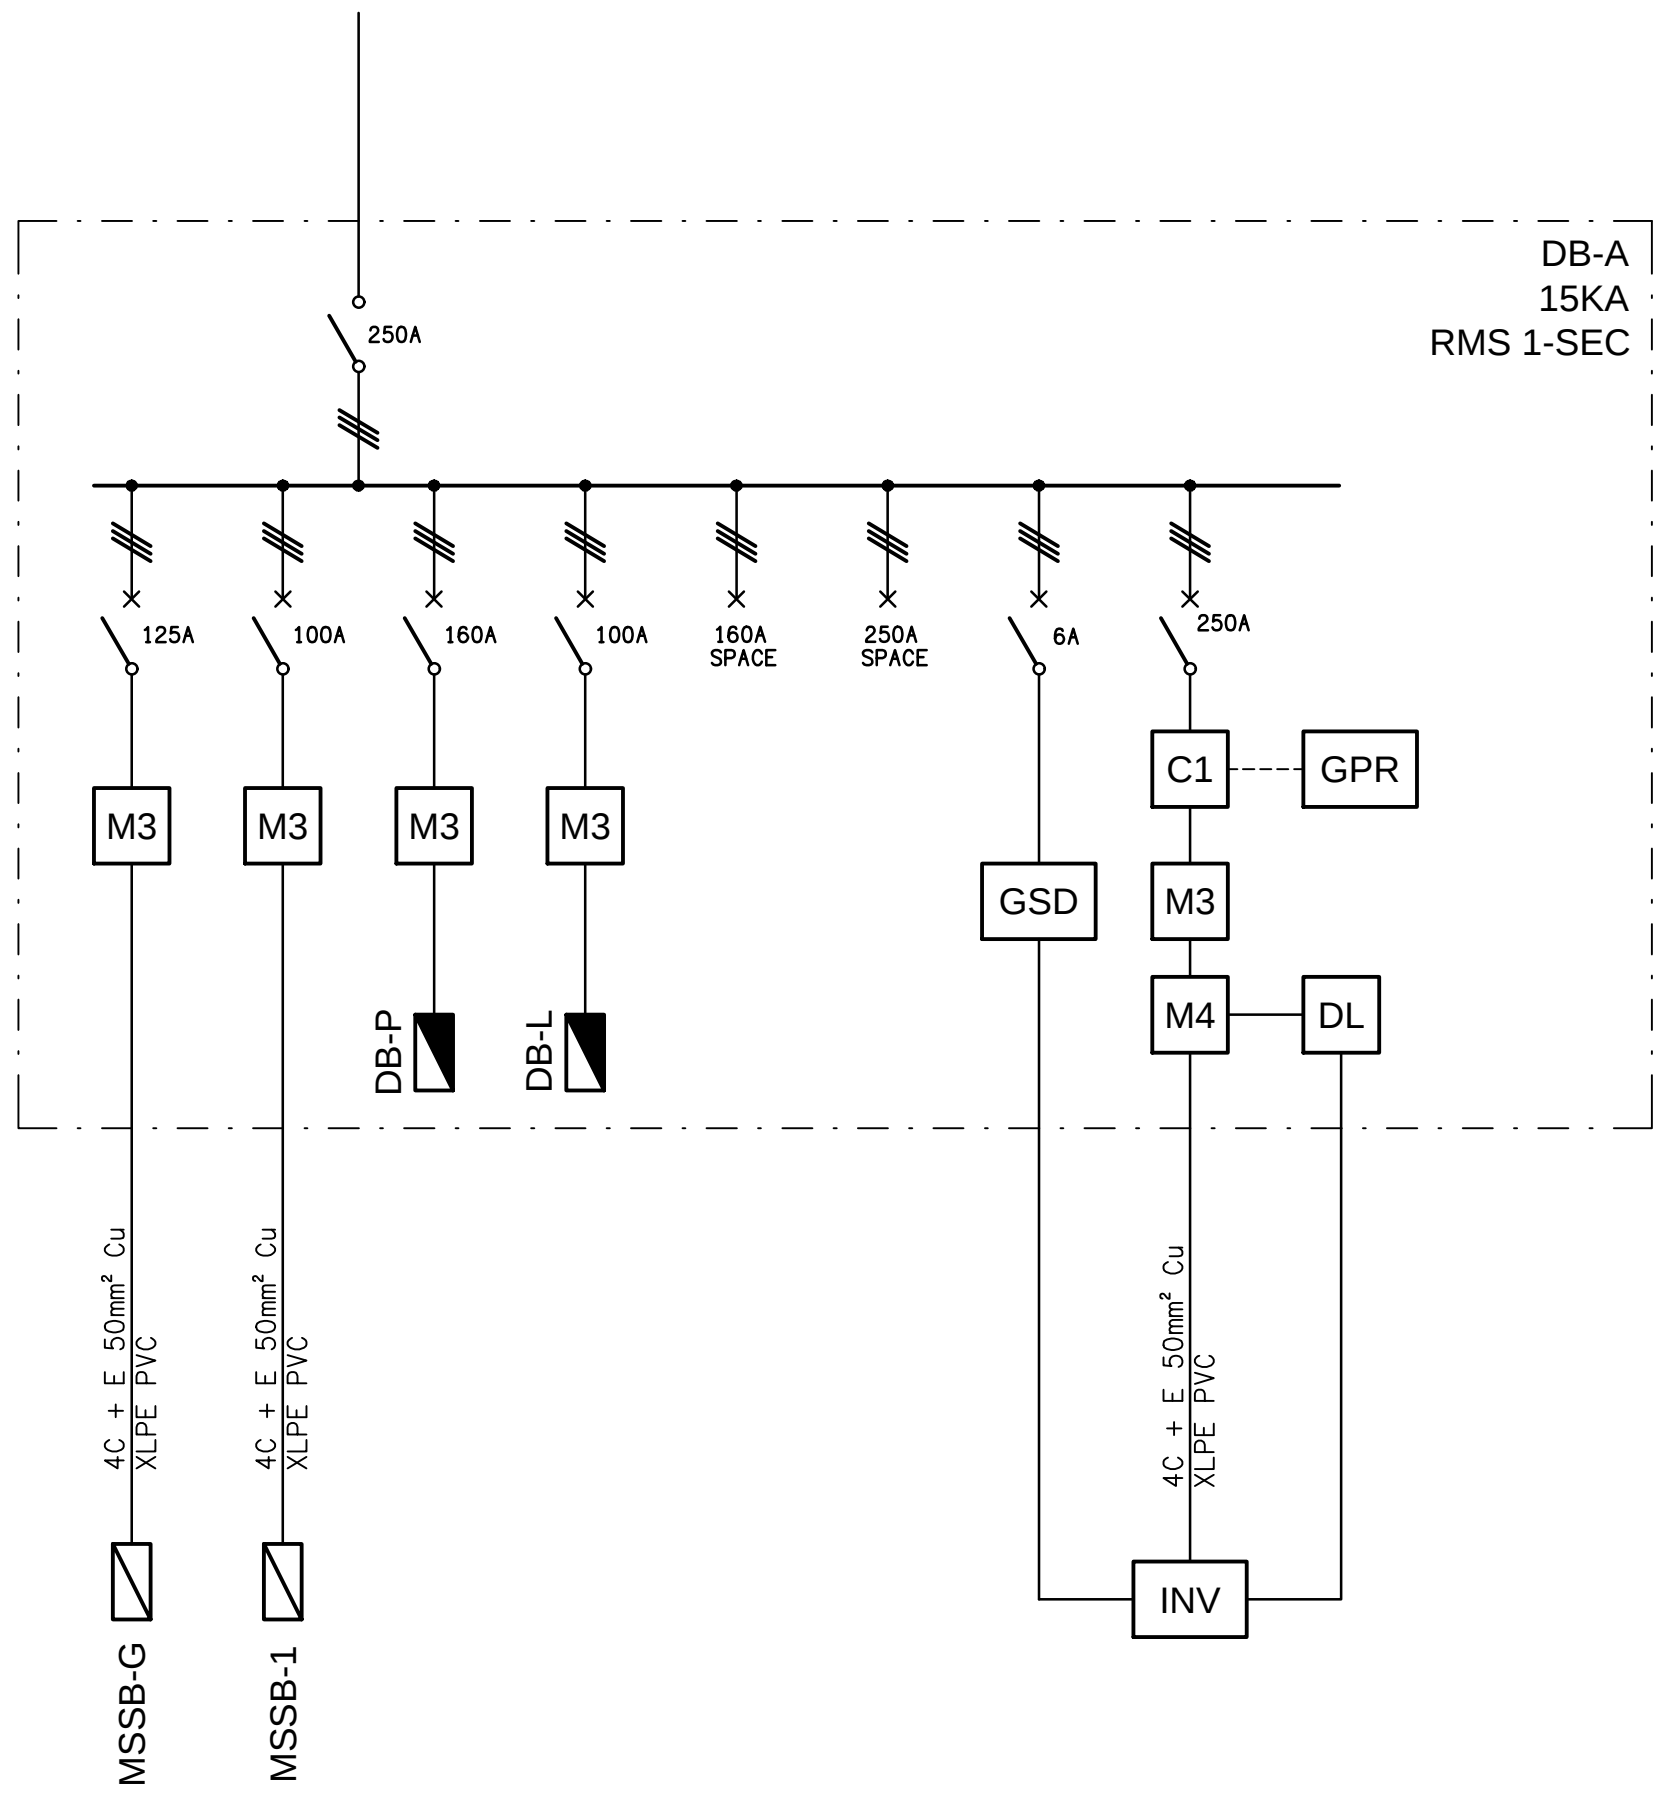


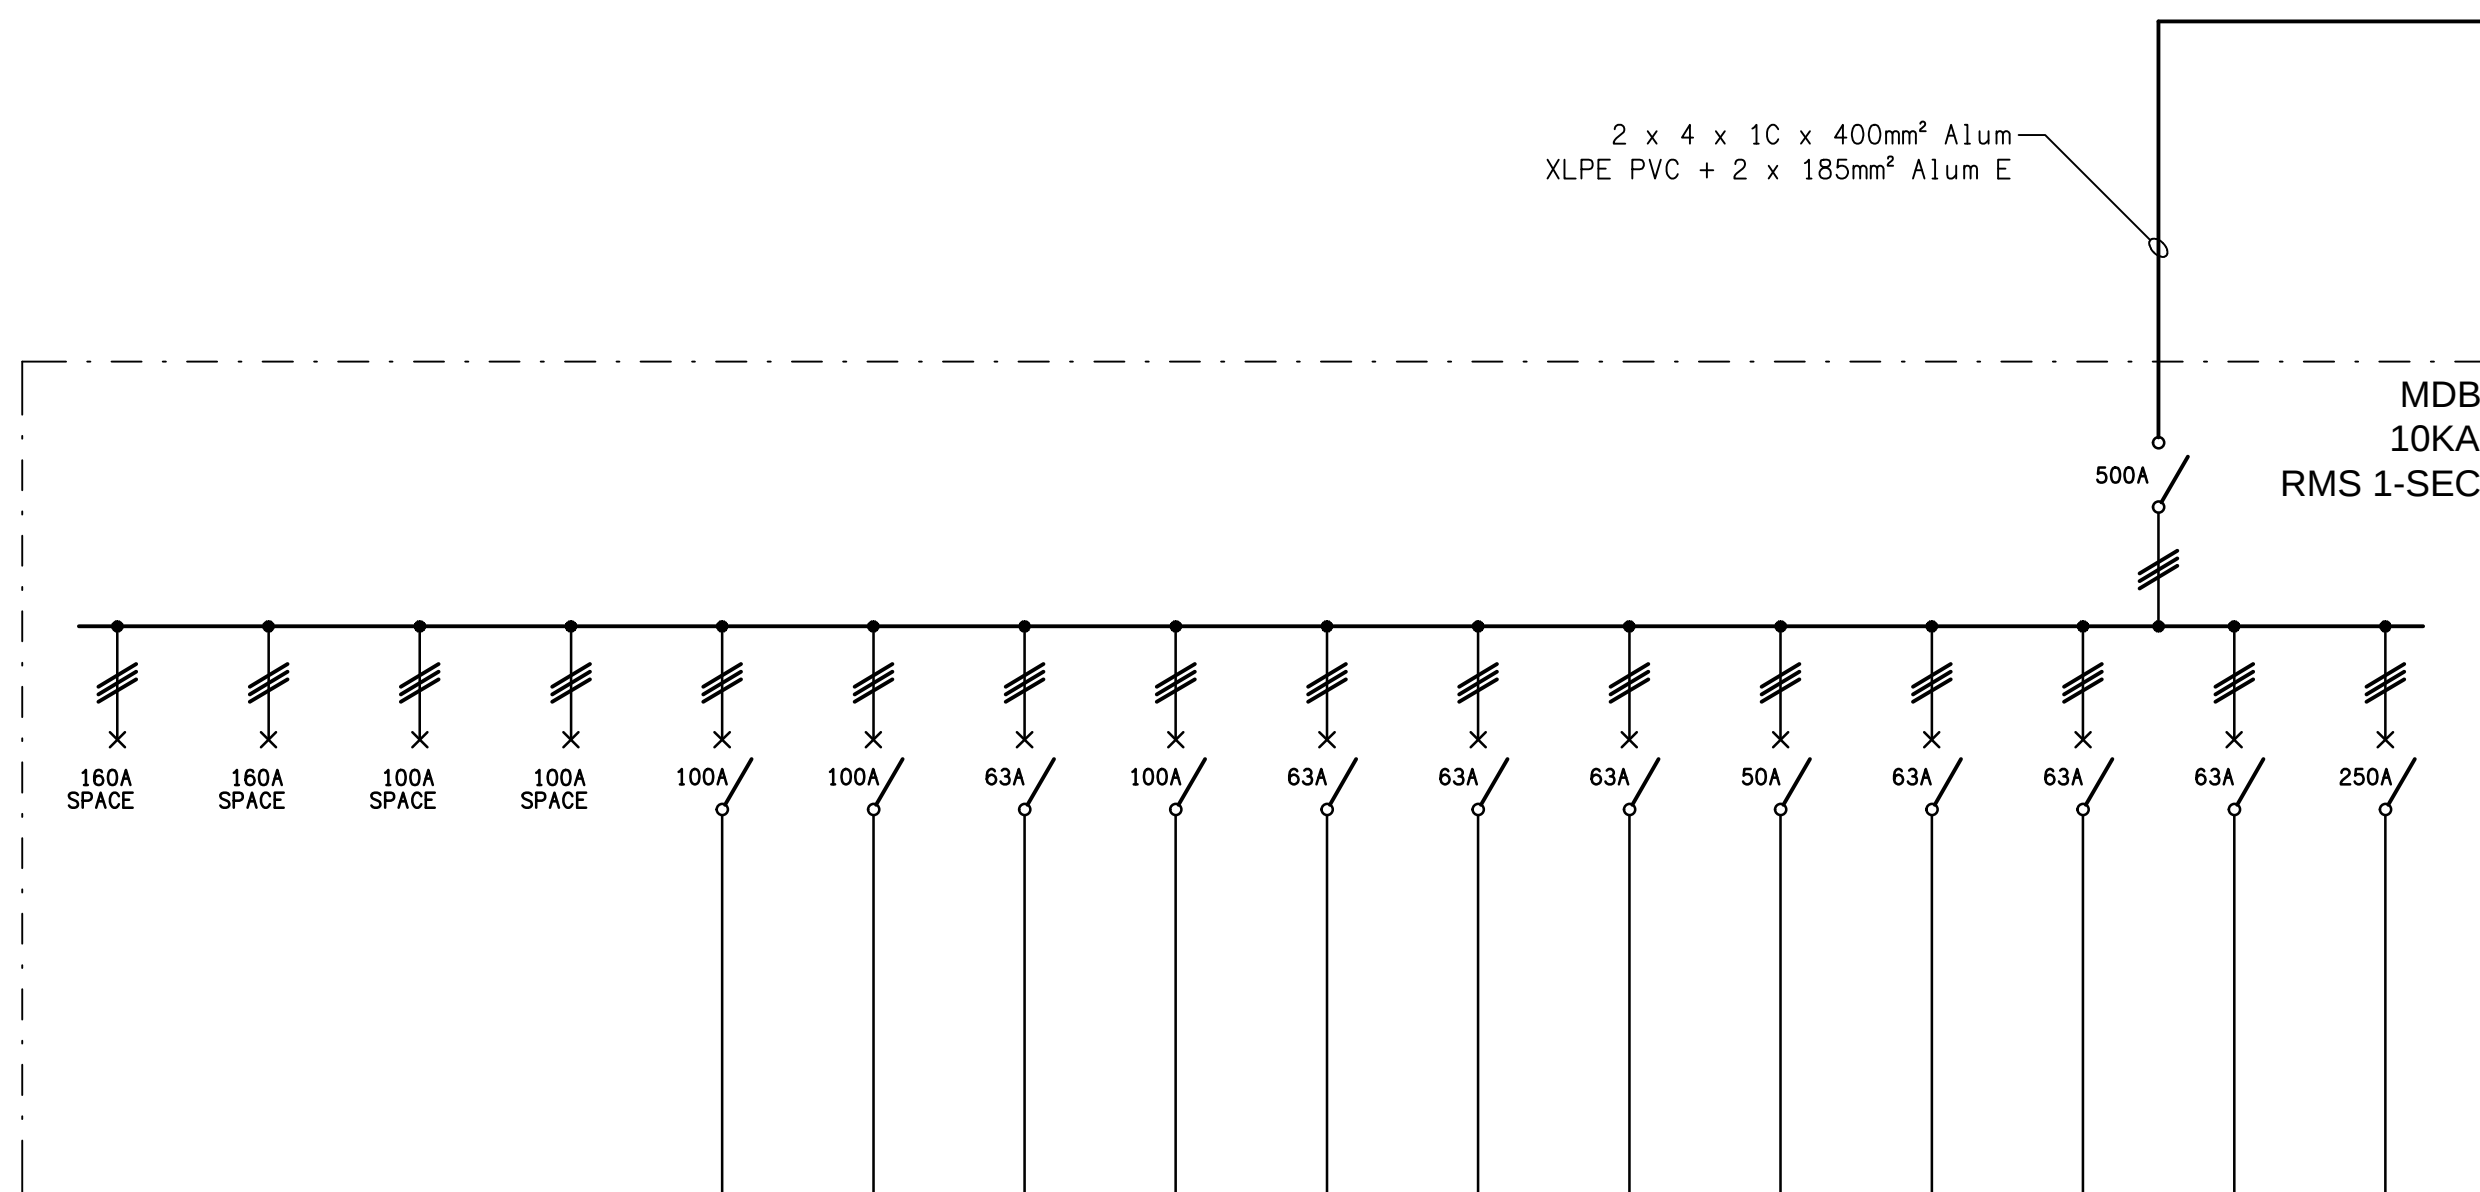

SCHEMATIC
DB-A CONFIGURATION
NOT TO SCALE

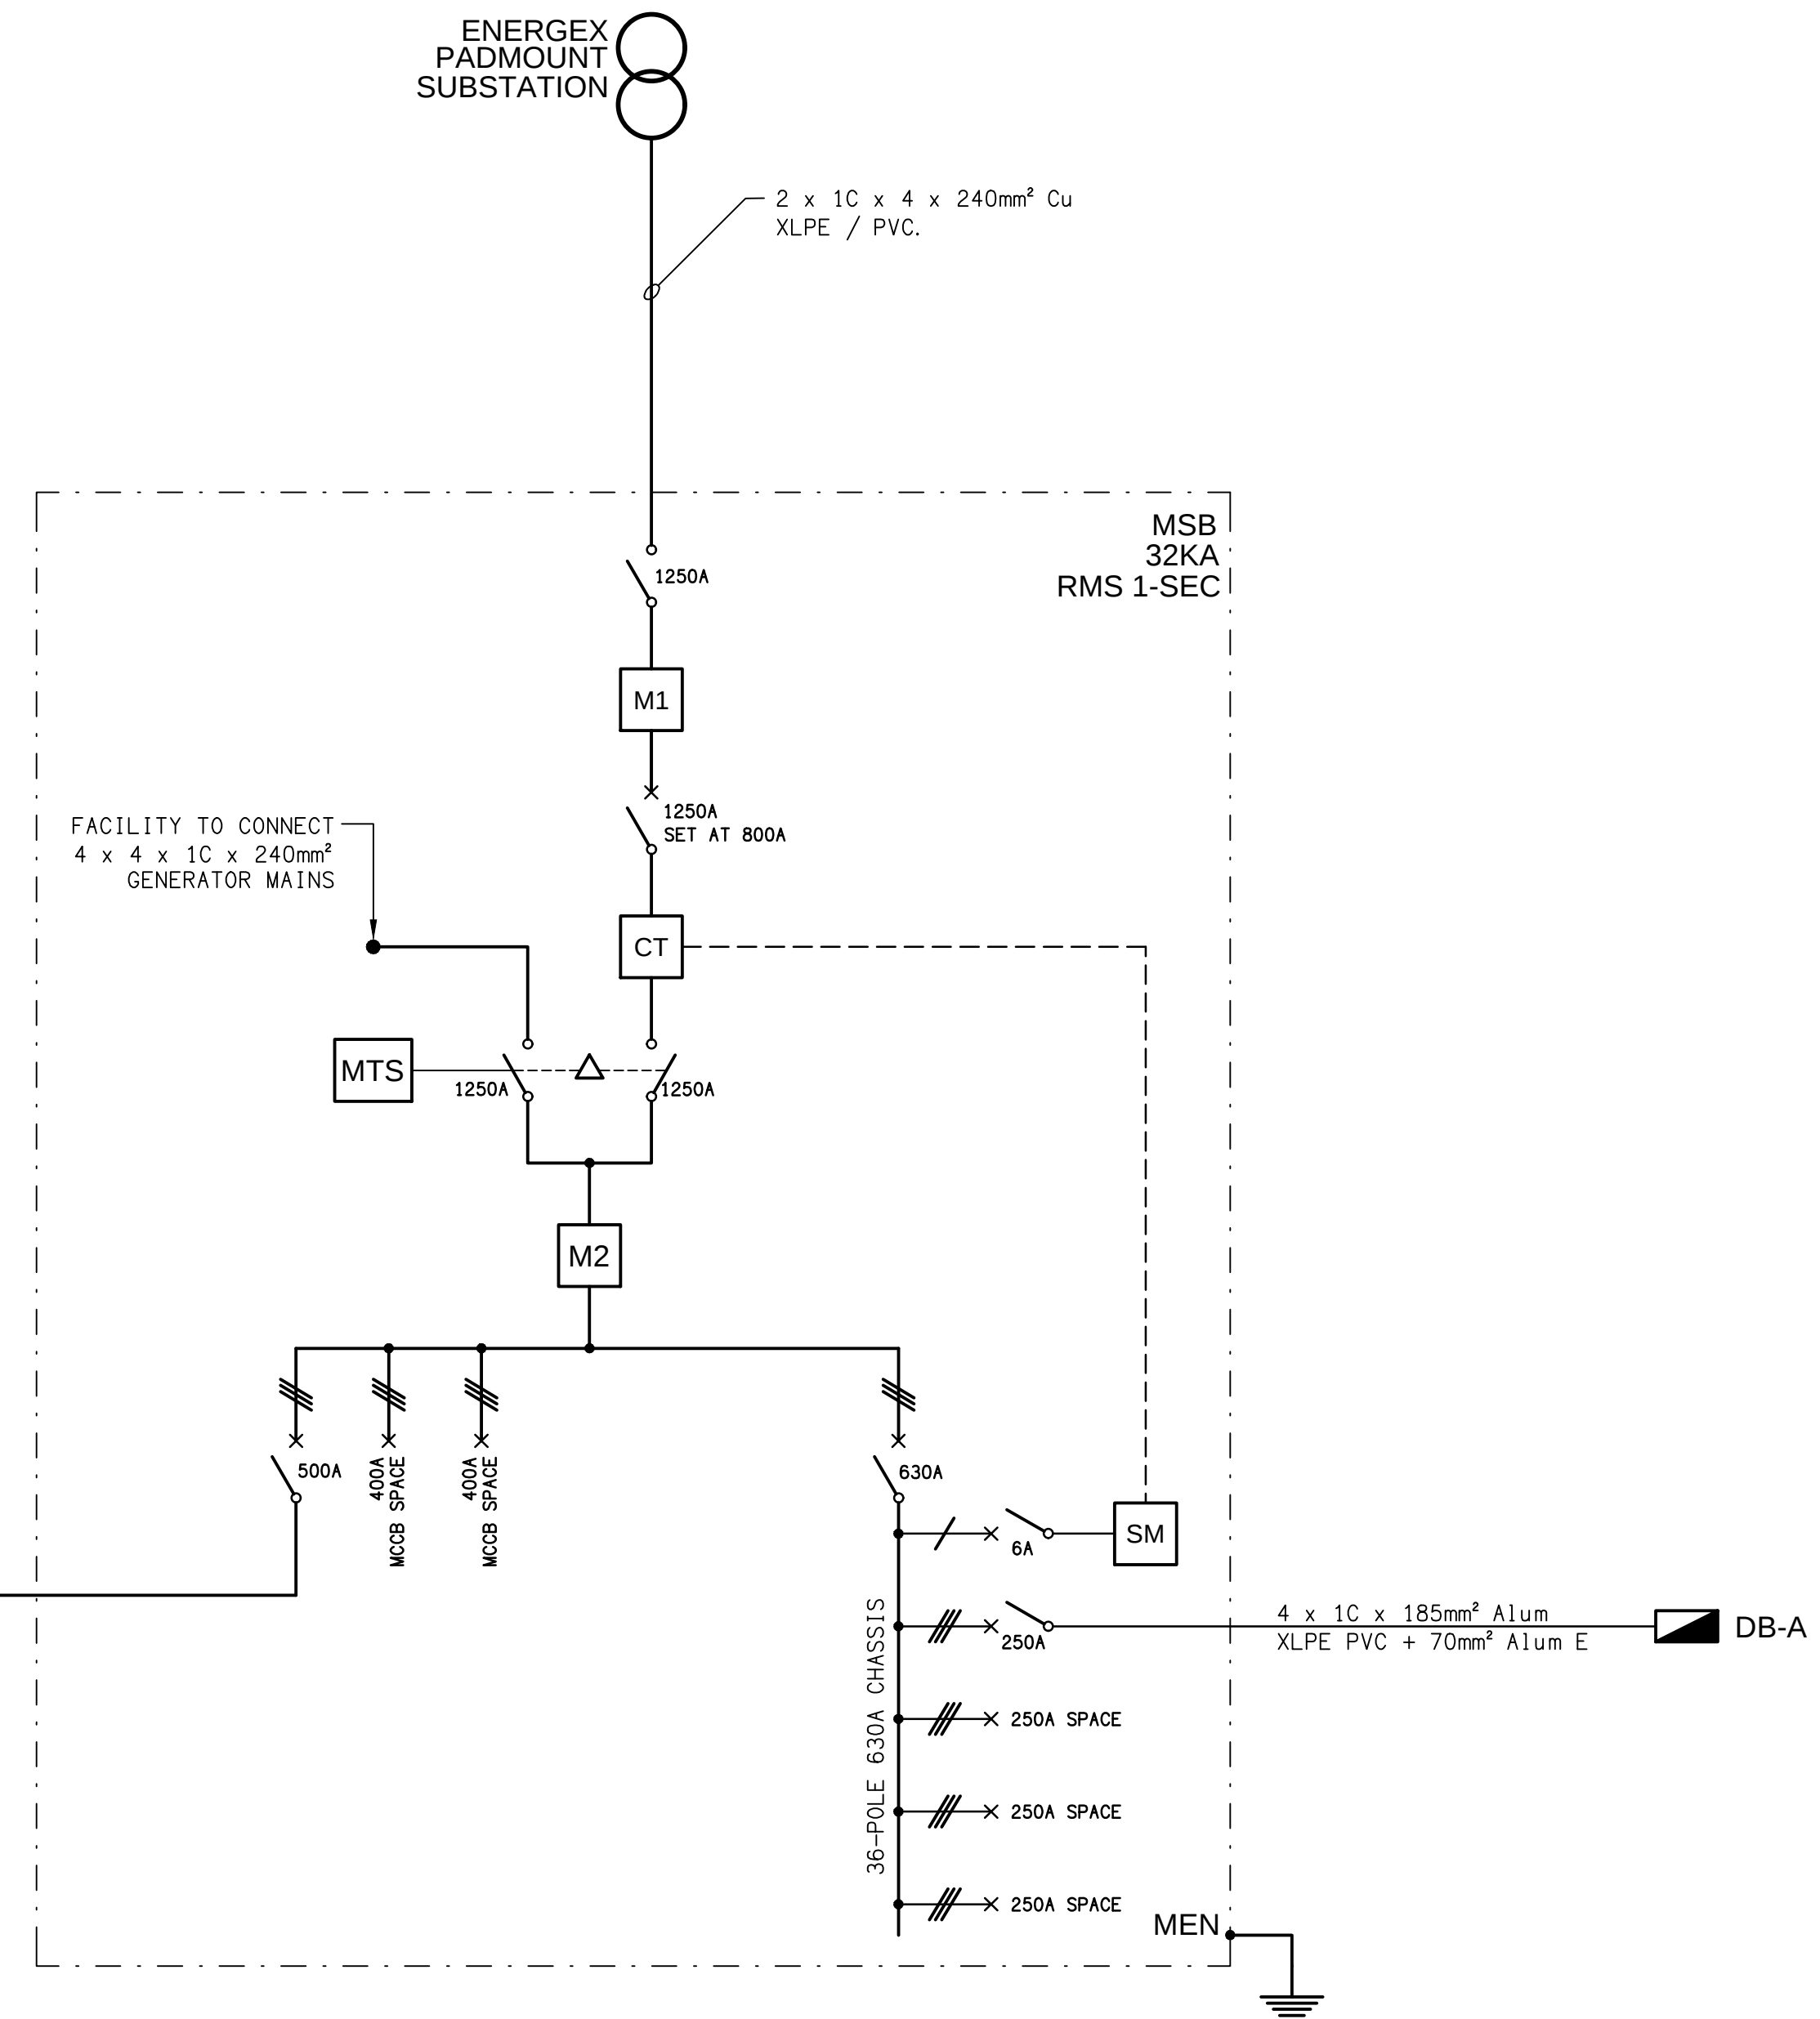

EXISTING UNDERGROUND SUBMAINS
TO BE RECONNECTED TO THE NEW
MDB.

ENERGEX ACCEPTANCE

NAME

OFFICE

SIGNED

DATE / /

ENERGEX takes no responsibility for the accuracy of the information provided on this drawing

